

The Department of Energy has published updated energy efficiency metrics for central air conditioners and heat pumps. This publication reflects both the 1987 metric (SEER) and the 2023 metric (SEER2). Efficiency requirements are published at 10 C.F.R. 430.32(c). Please refer to [www.AHRInet.org](http://www.AHRInet.org) for more information about updated energy efficiency metrics.


U.S. Government

Federal law prohibits removal of this label before consumer purchase.

# ENERGYGUIDE

Heat Pump  
Cooling and Heating  
Split System

MRCOOL  
Model MULTI2-18HP230B

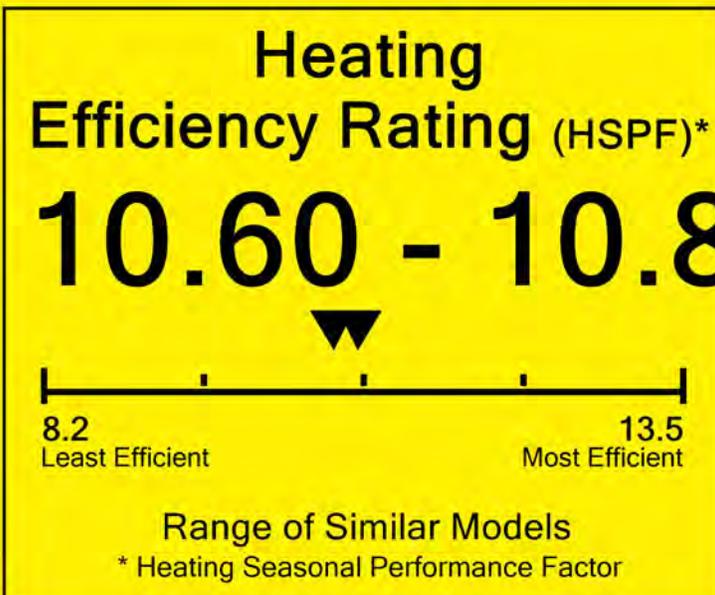

For energy cost info, visit  
[productinfo.energy.gov](http://productinfo.energy.gov)



U.S. Government

Federal law prohibits removal of this label before consumer purchase.

# ENERGYGUIDE

Heat Pump  
Cooling and Heating  
Split System

MRCOOL  
Model MULTI2-18HP230B

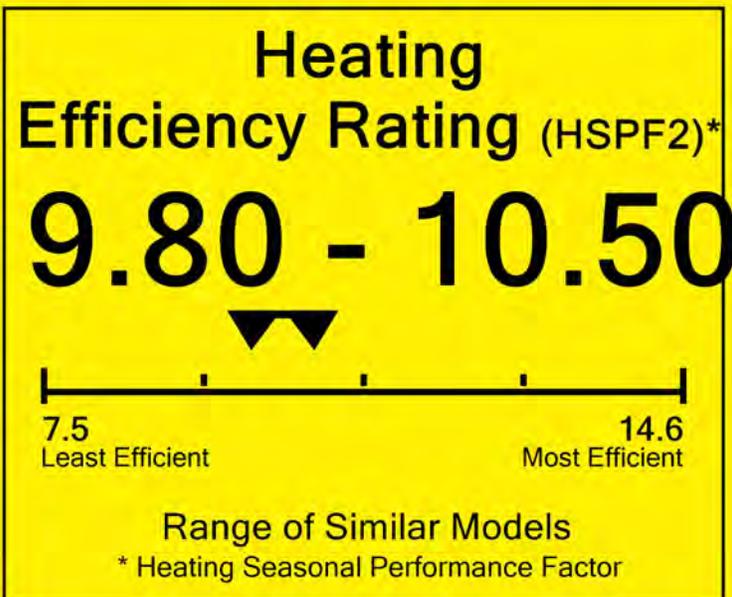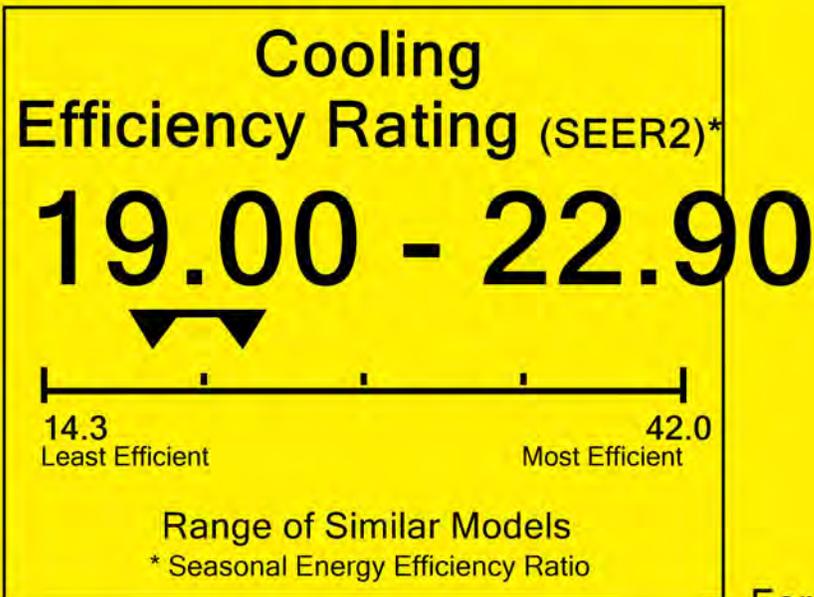

For energy cost info, visit  
[productinfo.energy.gov](http://productinfo.energy.gov)



U.S. Government

Federal law prohibits removal of this label before consumer purchase.

# ENERGYGUIDE

Heat Pump  
Cooling and Heating  
Split System

MRCOOL  
Model MULTI2-18HP230B

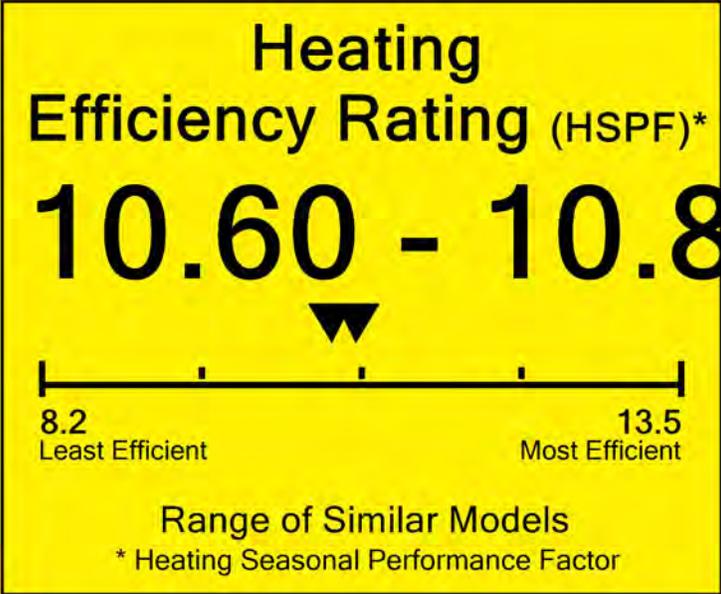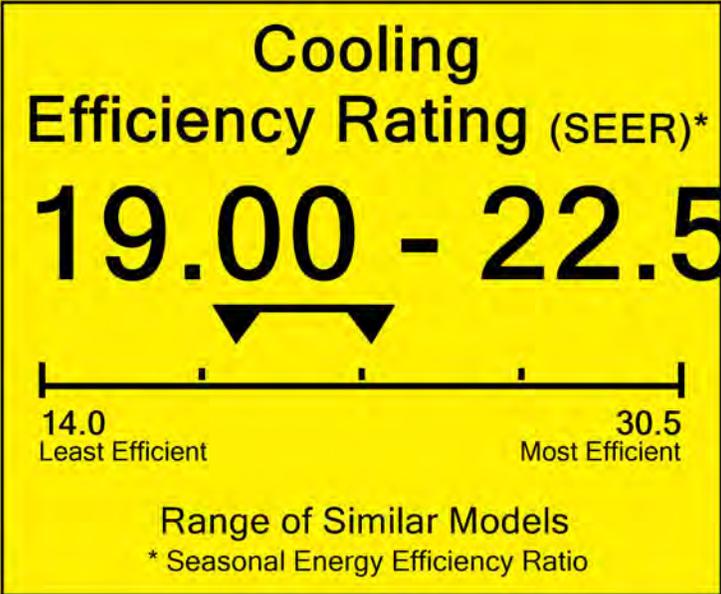

For energy cost info, visit [productinfo.energy.gov](http://productinfo.energy.gov)



U.S. Government

Federal law prohibits removal of this label before consumer purchase.

# ENERGYGUIDE

Heat Pump  
Cooling and Heating  
Split System

MRCOOL  
Model MULTI2-18HP230B

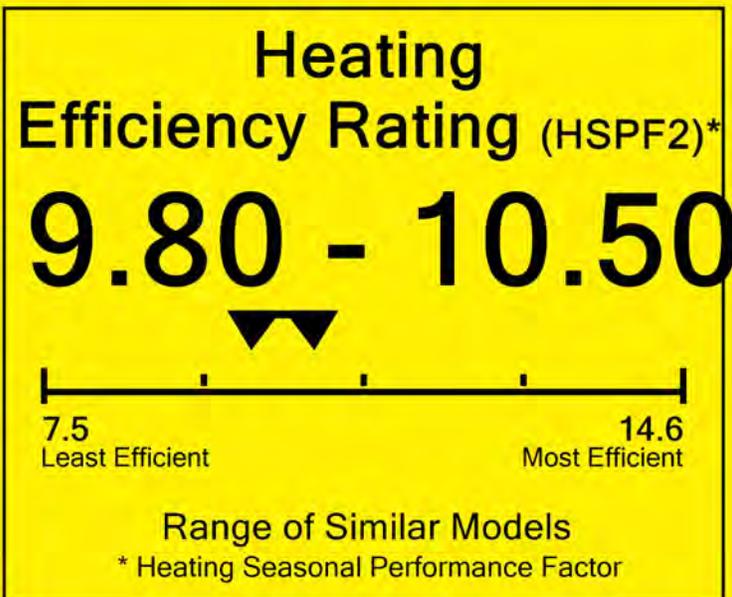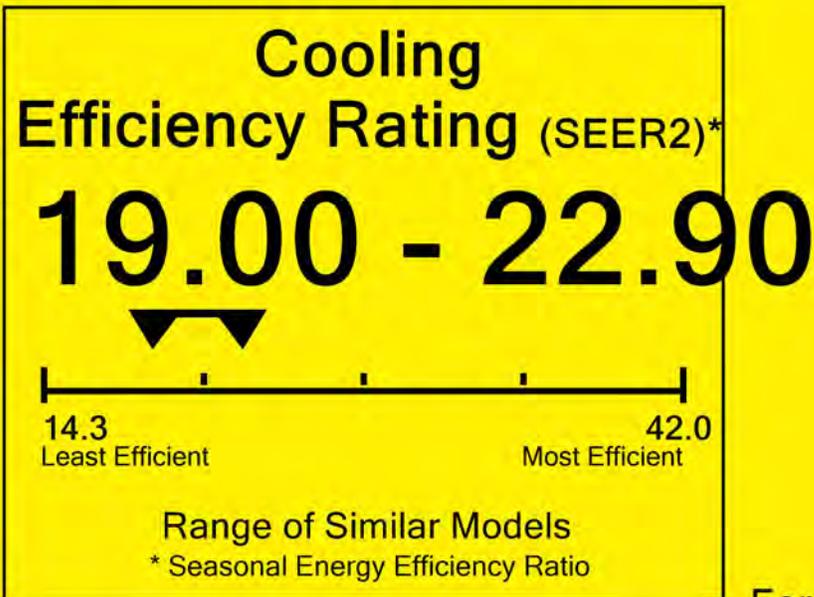

For energy cost info, visit [productinfo.energy.gov](http://productinfo.energy.gov)

U.S. Government

Federal law prohibits removal of this label before consumer purchase.

# ENERGYGUIDE

Heat Pump  
Cooling and Heating  
Split System

MRCOOL  
Model MULTI2-18HP230B



For energy cost info, visit  
[productinfo.energy.gov](http://productinfo.energy.gov)